

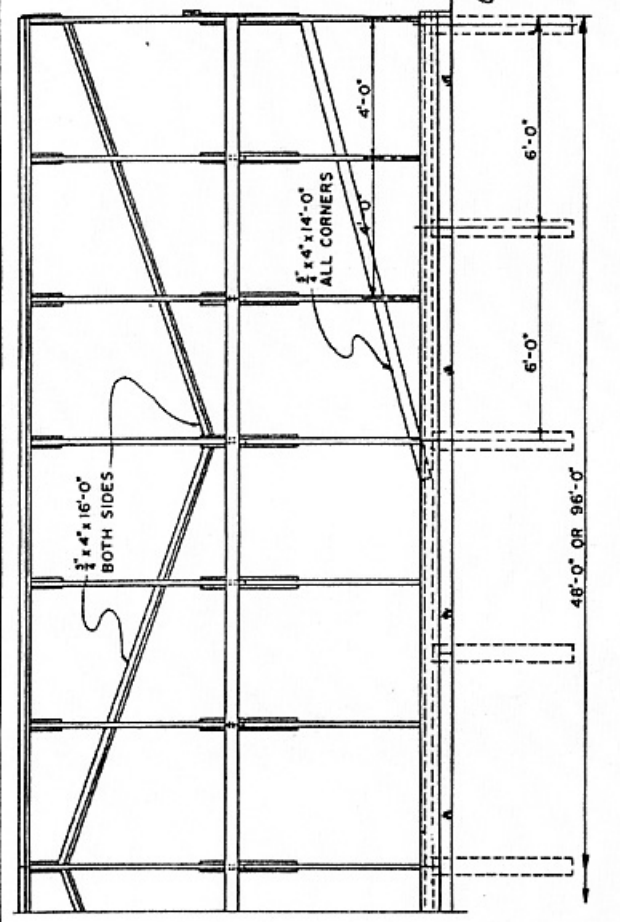


END ELEVATION

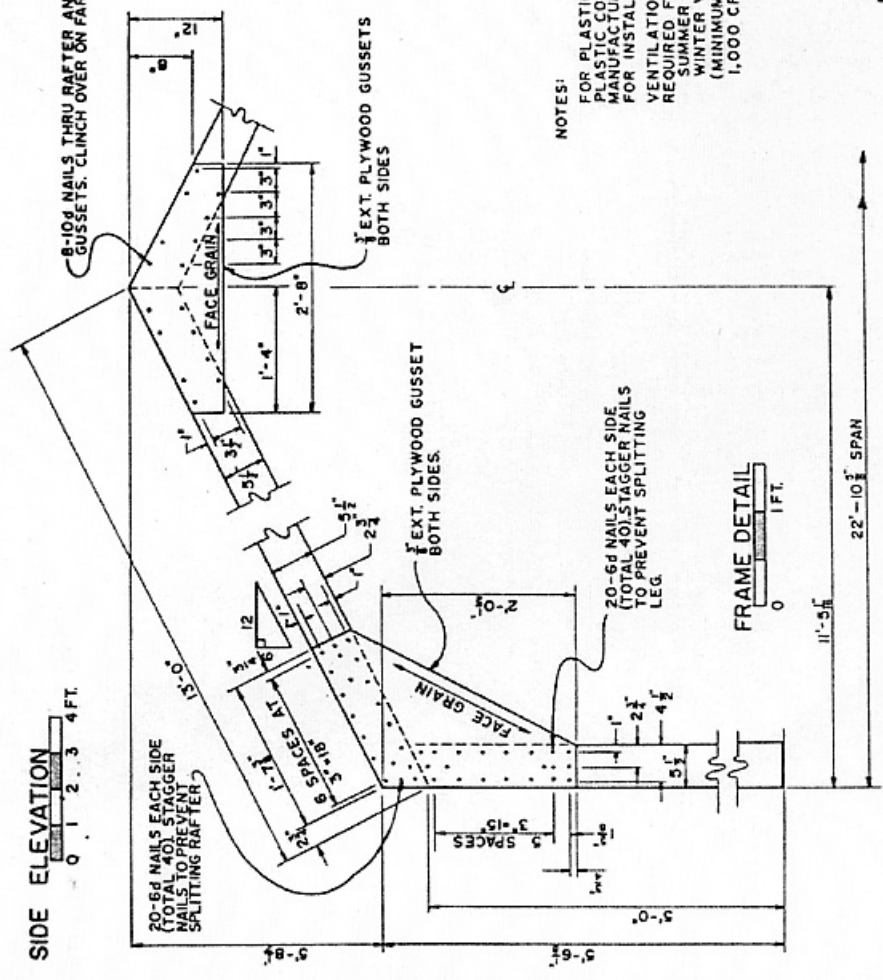

SIDE ELEVATION



PERSPECTIVE

NOTES:
 FOR PLASTIC FILM AND RIGID
 PLASTIC COVERING FOLLOW
 MANUFACTURER'S DIRECTIONS
 FOR INSTALLATION.
 VENTILATION AND HEATING
 REQUIRED FOR 23 x 48 HOUSE:
 SUMMER VENTILATION - 10,000 CFM
 WINTER VENTILATION - 660 CFM
 (MINIMUM AIR INTAKE - ONE SQ. FT. PER
 1,000 CFM)

COOPERATIVE EXTENSION WORK IN
 AGRICULTURE AND HOME ECONOMICS
 STATE OF TENNESSEE
 UNIVERSITY OF TENNESSEE
 AGRICULTURAL ENGINEERING DEPARTMENT
 AND
 UNITED STATES DEPARTMENT OF AGRICULTURE COOPERATING

GREENHOUSE FRAMING

N.J. '67 EX. 6029 SHEET 1 OF 2

NOTE: BASED ON N.J. PLAN NO. 139

